

Kidde Fire Protection

NATURA™ (400 Series) Inert Gas System

Component Description

Cylinder Valve


FEATURES

- For Approvals, see the “COMPATIBILITY” table.
- REACH and RoHS compliant
- Tested and CE marked according to EN 12094-4
- Tested and PI marked according to ADR D2/11

DESCRIPTION

The Kidde Fire Protection NATURA™ (400 Series) Inert Gas System valve is a pneumatically operated, high pressure, fast actuating cylinder valve for cylinder storage pressures of up to 300 bar. Each valve includes quick connect connectors (6mm) for the pilot actuation line to allow pneumatic opening of the valve at 8 Bar (116 Psi).

Once actuated, the valve’s intelligent flow control technology allows an outlet flow of ≈55 bar (797 psi). After a discharge, the cylinder valve closes automatically when the pressure falls below 3 bar (44 psi). The valve is also designed to safely self-close at ≈70 bar (1015 psi) if released into a closed pipe section without a flowing condition.

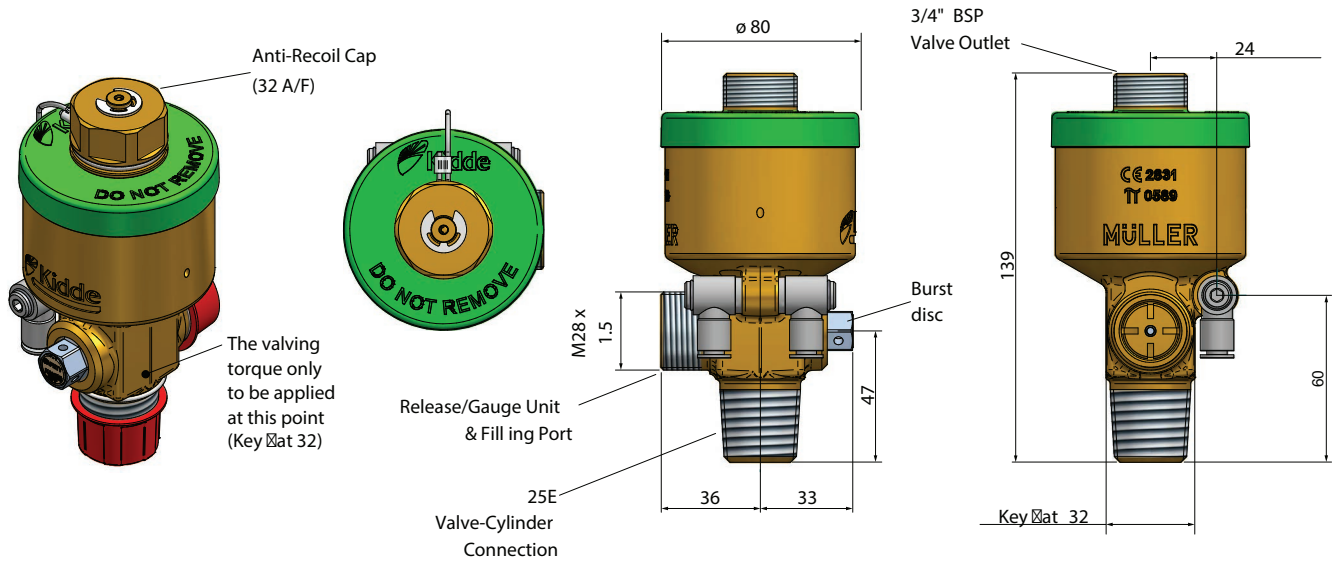

SPARE PARTS INFORMATION

Part Number	Description
38-400000-001	NATURA™ (400 Series) Valve
38-400011-001	Anti-Recoil Cap, with Actuation Test Pin

SPECIFICATIONS:

Material: Brass
 Approx. Weight: 1.76 kg (3.88lb)
 Actuation Pressure: 8 Bar (116 Psi)
 Max Number of Operations: 10
 Working Pressure: 300 Bar (4351 Psi)
 Test Pressure: 555 Bar (1031 Psi)
 Burst Disc: 450 Bar (580 Psi) +0/10% from -20 to 65°C (-68 to 149°F)

COMPATIBILITY

Series	DIOM P/N	Approvals*
Natura IGS system	06-237518-001	LPCB, FM, UL

* For additional listings, contact Kidde Fire Protection

Temperature Range(s):
 ISO/EN: -20° to 50°C (-4° to 122°F)
 FM Approved / UL Listed: -20° to 54°C (-4° to 130°F)*
 *Unless superseded by local/national standards

This literature is provided for informational purposes only. Kidde-Fenwal, LLC believes this data to be accurate, but it is published and presented without any guarantee or warranty whatsoever. Kidde-Fenwal, LLC assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, LLC, Ashland, MA 01721.

Kidde-Fenwal, LLC
400 Main Street
Ashland, MA 01721, USA

KFI U.K. Limited
Station Road,
Bentham, Lancaster, LA2 7NA, UK

Kidde Technologies
Survey No. 28/2, 44/2 and 45
Rasyani, Dandapta Road
Raigad Maharashtra-410207, India